


NOTES:

1. REFER TO SECTION I OF THE MORNINGTON PENINSULA SHIRE STANDARD SPECIFICATION FOR ROAD AND DRAINAGE WORKS.
2. ALL MEASUREMENTS ARE IN MILLIMETRES.
3. SUBSOIL DRAINS MUST NOT BE CONSTRUCTED UNTIL AFTER KERB AND CHANNEL IS CAST.
4. WHERE SUBSOIL DRAINAGE IS LAID UNDER ROAD PAVEMENT, THEN IT SHALL BE BACK-FILLED WITH "NO FINES" CONCRETE IN ACCORDANCE WITH CLAUSE I.2 OF THE SPECIFICATION.

APPROVED GEOTEXTILE FILTER FABRIC. GEOTEXTILE MUST COMPLETELY COVER THE SCREENINGS BY OVERLAPPING THE TRENCH BY 150mm. FABRIC MUST BE PLACED WITHIN 24 HOURS OF SCREENINGS BEING PLACED.

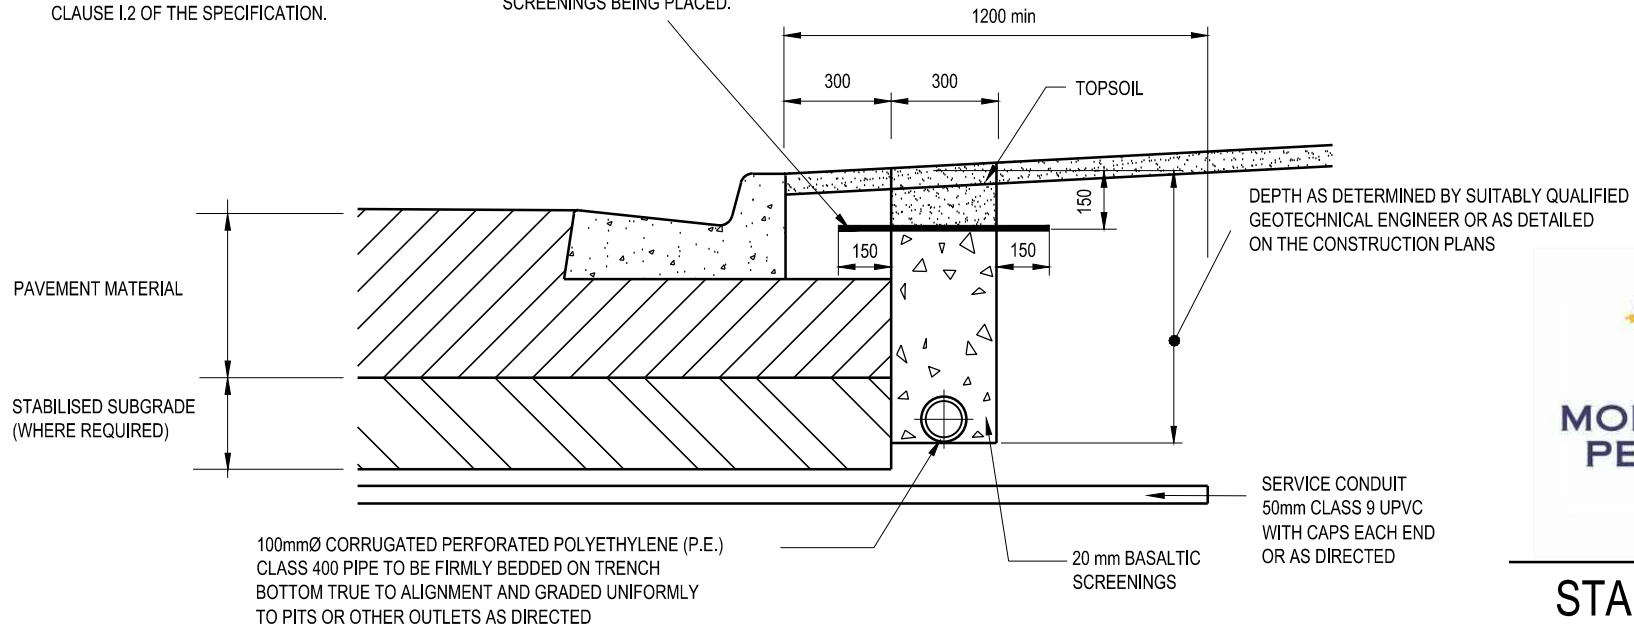

LOCATION OF SUBSOIL DRAINAGE PIPE

SCALE 1:20



STANDARD PLAN

**SUBSOIL DRAINAGE
PIPE LOCATION**

CERTIFICATION

D. Rotter
DEREK ROTTER - MANAGER PROJECT DELIVERY

DATE OF ISSUE: Sept 2015

SHEET NO.: 1 OF 1

MP227