


PLAN VIEW

SCALE 1:20


NOTES:

- 1 PIT IS TO BE CAST INSITU ONLY
- 2 OVERALL WIDTH OF PIT VARIES. WIDTH SHALL EQUAL DIAMETER OF STORAGE PIPE + 150 MINIMUM. THE MINIMUM PIT WIDTH SHALL BE 600mm.
- 3 IF PIT WIDTH IS 600mm OR 900mm STANDARD LIDS CAN BE USED. IF THE WIDTH IS NON STANDARD A CUSTOM LID SHALL BE OBTAINED FROM THE MANUFACTURER.
- 4 DIAMETER OF ORIFICE AT BASE OF BAFFLE WALL TO SUIT PERMISSIBLE SITE DISCHARGE.
- 5 THIS DRAWING SHOWS GUIDELINE DETAILS ONLY. FINAL DESIGN TO BE PREPARED BY A CONSULTING ENGINEER TO THE SATISFACTION OF THE RESPONSIBLE AUTHORITY.

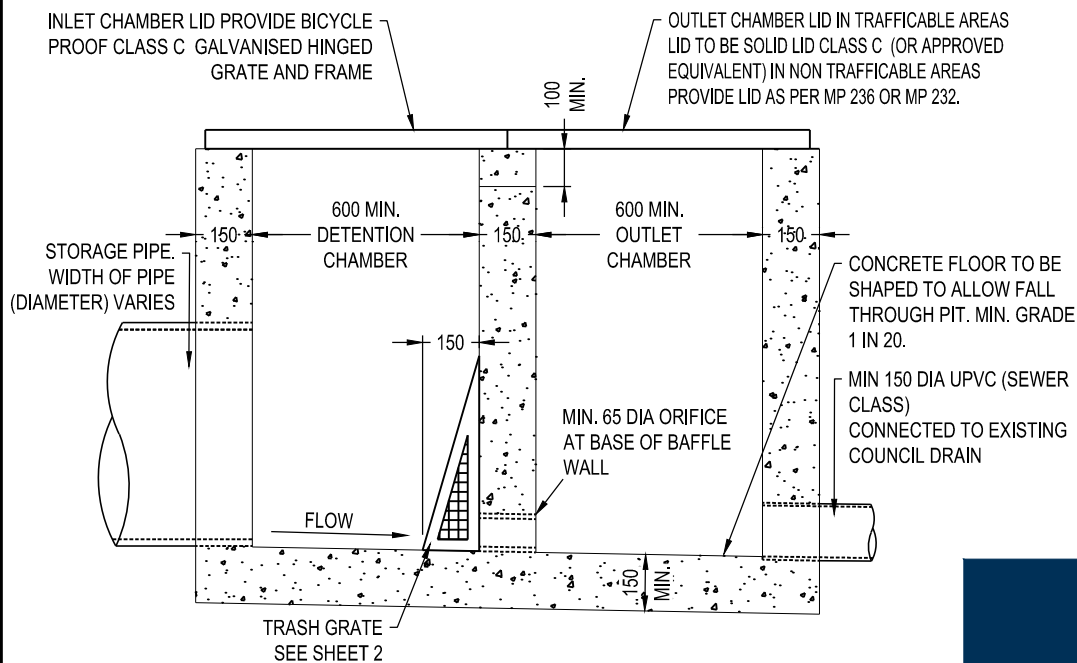

SECTION A-A

SCALE 1:20

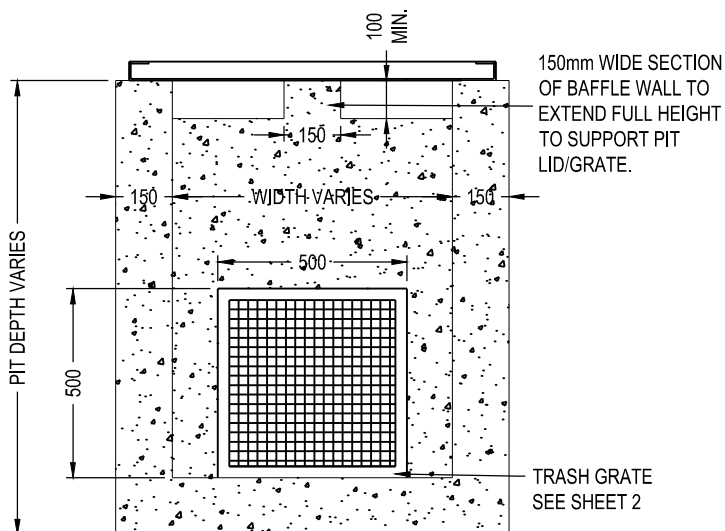

SECTION B-B

SCALE 1:20



MORNINGTON
PENINSULA
Shire

STANDARD PLAN
ORIFICE PIT
PIT AND LID DETAILS

MANAGER - INFRASTRUCTURE PROJECTS

DATE OF ISSUE
SHEET NO

05/12/2024
1 OF 2

MP244.1